



AUX Control Panel QUICK START GUIDE



Scan for Equipment / Parts & Service
www.darpro-solutions.com

61-10143

1 REMOTE TANK INDICATOR INSTALLATION

- This installation method is used when there is no pump station included with the install.
- Confirm the installation location of the AUX control panel. The system must be located within 15' of an outlet.
- The 72" caddy cord should be disconnected from the panel.

OPTIONAL: You can disable DIP 2 on the underside connection port to prevent the push to pump button from illuminating/functioning.




Carefully loosen one edge of the plastic snap-in cover.



Remove the plastic snap-in cover by hand. Keep the plastic cover.




Set DIP switches as pictured. Reinstall plastic cover.

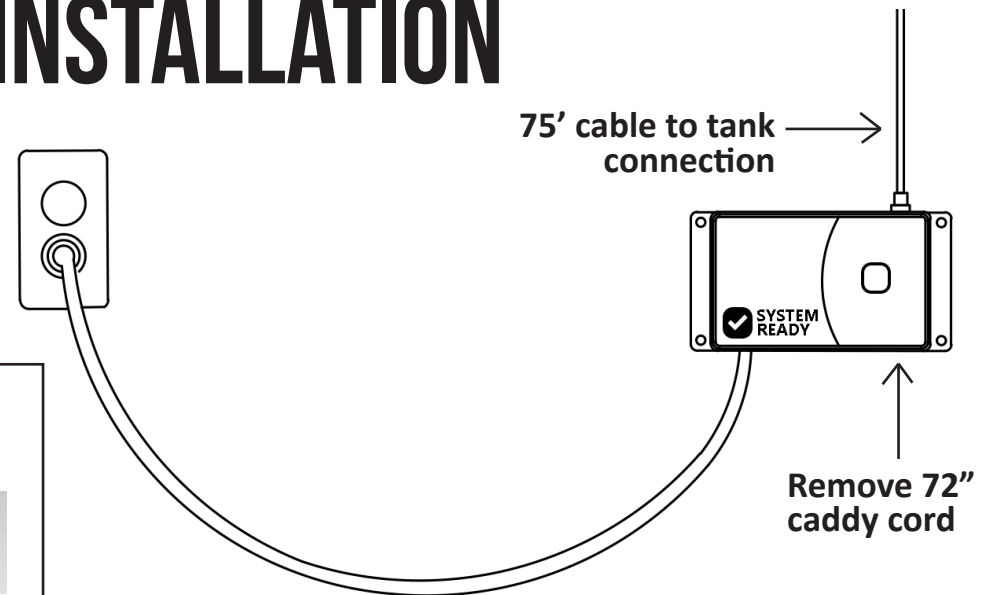

- See Section 3 for Tank Connection


REMOTE PUSH TO PUMP INSTALLATION

- Confirm the installation location of the AUX control panel. The system must be located within 15' of an outlet and 72" from the pump station.
- Connect the 72" caddy cord to the pigtail on the pump station. Make sure the cord is fully inserted into the AUX control panel bottom receptacle.
- Make sure the pump station is powered ON.
- If your kit includes a 75' remote cable, you will need to run this cable from the AUX control panel to the tank. **See Section 3 for Tank Connection**

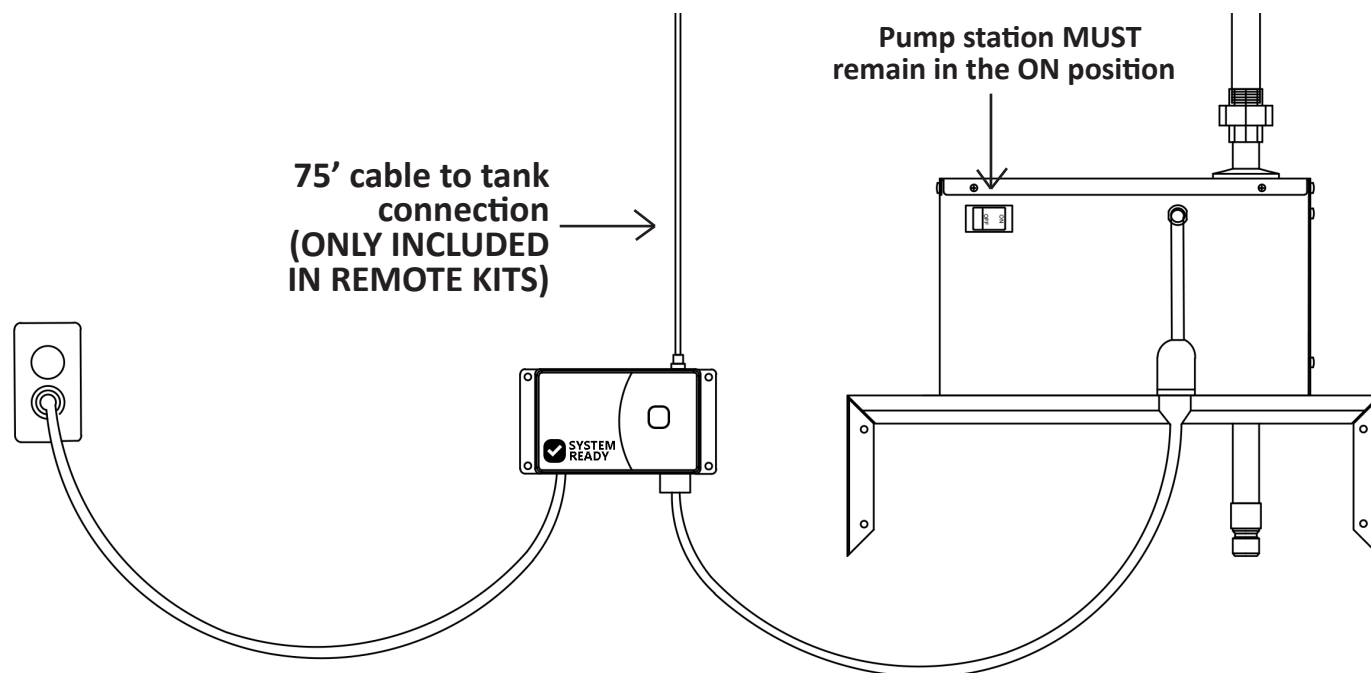


2500 TANK CONNECTION


Locate the 4x4 junction nearest to the main control panel.

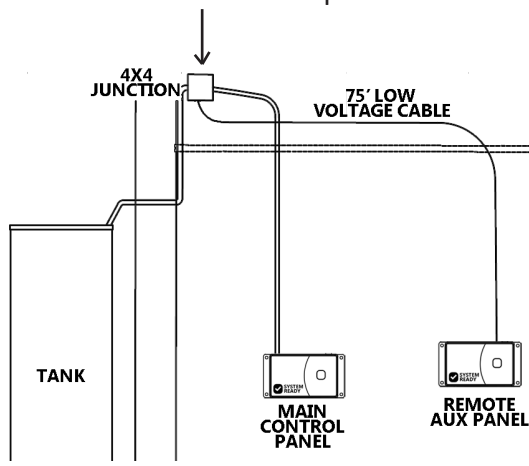


Make the connection **INSIDE** the junction. Do NOT leave any connectors outside of the junction box. Tighten the wire gland around the 75' cable.

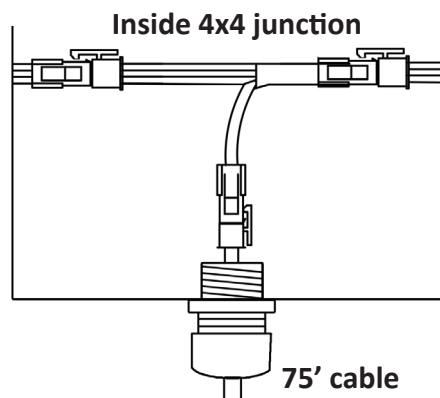

1500 TANK CONNECTION



Locate the top access port on the tank. Loosen the cover. Connect the jumper to the float and panel as pictured below.

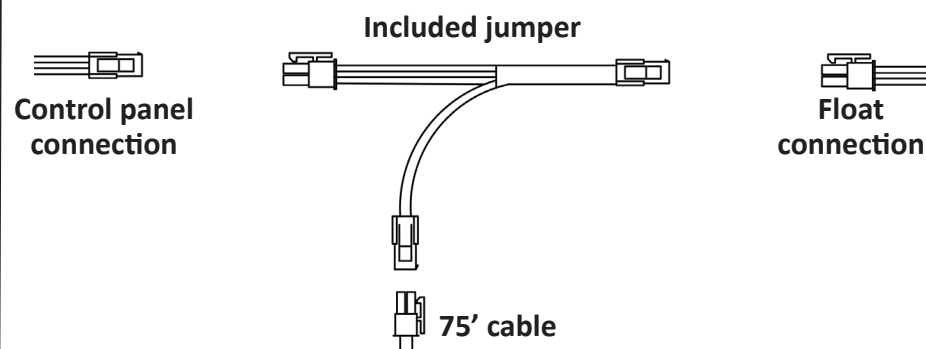

FOR ASSISTANCE CALL: 1-800-486-0101